



Cement Mill Test Report

Date of Issue: May 08, 2025

Plant: Exshaw AB
Product: Portland Cement Type I/II
Mill Test Report Number: ESW_Type I-II 2025-04
Manufactured during the month of: April 2025

ASTM C 150-24 and AASHTO M 85-24 Standard Requirements

CHEMICAL ANALYSIS			PHYSICAL ANALYSIS		
Item	Spec limit	Test Result	Item	Spec limit	Test Result
Rapid Method, X-Ray (C114)			Air content of mortar (%) (C185)		
SiO ₂ (%)	---	19.3		12 max	6
Al ₂ O ₃ (%)	6.0 max	4.0	Blaine Fineness (m ² /kg) (C204)		
Fe ₂ O ₃ (%)	6.0 max	3.5		260 min	383
CaO (%)	---	61.7	Passing 45 µm (%) (C430)		
MgO (%)	6.0 max	4.8		---	98.5
SO ₃ (%)*	3.0 max *	3.3	Compressive strength (MPa, [psi]) (C 109)		
Loss on Ignition (%)	3.5 max	2.4	3 days	12.0 [1740] min	27.8 [4035]
Insoluble Residue (%)	1.5 max	0.3	7 days	19.0 [2760] min	33.2 [4813]
CO ₂ (%)	---	1.8	28 days (Previous Month's Result)		42.5 [6163]
Limestone (%)	5.0 max	4.2	Time of setting (minutes)		
CaCO ₃ in Limestone (%)	70 min	96.0	Vicat Initial (C191)	45 - 375	90
Inorganic Process Addition (Lafarge Cement Kiln Dust)	5.0 max	--	Mortar Bar Expansion (%) (C1038)**		
Adjusted Potential Phase Composition (C50)				0.020 max	0.016
C ₃ S (%)	---	56			
C ₂ S (%)	---	13			
C ₃ A (%)	8 max	5			
C ₄ AF (%)	---	10			
C ₃ S+4.75*C ₃ A (%)	100 max	79			

ASTM C 150-17 and AASHTO M 85-17 Optional Requirements:

Na ₂ Oeq	0.60 max	0.55	False set (%) (C451)	50 min	74
---------------------	----------	------	----------------------	--------	----

* May exceed the SO₃ maximum based on C 1038 results of <0.020% expansion at 14 days.

We certify that the above described cement, at the time of shipment, meets the chemical and physical requirements of:

ASTM C 150-24 & AASHTO M 85-24 STANDARD SPECIFICATIONS FOR TYPES I / II CEMENTS; and
ASTM C 150-24 & AASHTO M 85-24 OPTIONAL CHEMICAL REQUIREMENTS FOR TYPES I / II LOW ALKALI CEMENT.

AASHTO Accreditation Exceptions: C430

Western Canada BU - Exshaw Plant
P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
Phone: 403-673-3815

Certified By:

John W Blair
Quality Manager



Certified to
NSF/ANSI/CAN 61



AASHTO
ACCREDITED



Cement Mill Test Report

Date of Issue: May 08, 2025

Plant: Exshaw AB
Product: Portland Cement Type I/II
Mill Test Report Number: ESW_Type I-II 2025-04
Manufactured: April 2025

ASTM C 150-24 and AASHTO M 85-24 Standard Requirements

Additional Data

Item	Test Result	
	Limestone	Inorganic Process Addition Lafarge Cement Kiln Dust
Amount (%)	4.2	--
SiO ₂ (%)	2.8	13.8
Al ₂ O ₃ (%)	0.5	3.7
Fe ₂ O ₃ (%)	0.4	2.0
CaO (%)	47.8	45.7
SO ₃ (%)	0.2	2.9
CO ₂ (%)	42.4	n/a

Base Cement Phase Composition

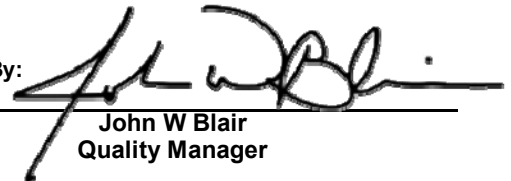
Item	Test Result
C ₃ S (%)	58
C ₂ S (%)	14
C ₃ A (%)	5
C ₄ AF (%)	11

Specific Gravity: 3.16 For information purposes only.

We certify that the data above reflects the materials used in cement manufacture during the production period indicated.

Western Canada BU - Exshaw Plant
P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
Phone: 403-673-3815

Certified By:


John W Blair
Quality Manager