



Cement Mill Test Report

Date of Issue: December 8, 2025

Plant: Exshaw AB
Product: Portland Cement Type I/II
Mill Test Report Number: ESW_Type I-II 2025-11
Manufactured during the month of: November 2025

ASTM C 150-24 and AASHTO M 85-24 Standard Requirements

CHEMICAL ANALYSIS			PHYSICAL ANALYSIS		
Item	Spec limit	Test Result	Item	Spec limit	Test Result
Rapid Method, X-Ray (C114)			Air content of mortar (%) (C185)	12 max	6
SiO ₂ (%)	---	19.0	Blaine Fineness (m ² /kg) (C204)	260 min	422.09
Al ₂ O ₃ (%)	6.0 max	4.1	Passing 45 µm (%) (C430)	---	98.7
Fe ₂ O ₃ (%)	6.0 max	3.4	Compressive strength (MPa, [psi]) (C 109)		
CaO (%)	---	61.5	3 days	12.0 [1740] min	29.5 [4,274]
MgO (%)	6.0 max	4.8	7 days	19.0 [2760] min	36.2 [5,249]
SO ₃ (%)*	3.0 max *	3.4	28 days <u>(Previous Month's Result)</u>		44.8 [6,489]
Loss on Ignition (%)	3.5 max	2.6	Time of setting (minutes)		
Insoluble Residue (%)	1.5 max	0.3	Vicat Initial (C191)	45 - 375	98
CO ₂ (%)	---	1.7	Mortar Bar Expansion (%) (C1038)**	0.020 max	0.012
Limestone (%)	5.0 max	4.0			
CaCO ₃ in Limestone (%)	70 min	88			
Inorganic Process Addition (Lafarge Cement Kiln Dust)	5.0 max	--			
Adjusted Potential Phase Composition (C50)					
C ₃ S (%)	---	56			
C ₂ S (%)	---	12			
C ₃ A (%)	8 max	5			
C ₄ AF (%)	---	10			
C ₃ S+4.75*C ₃ A (%)	100 max	80			

ASTM C 150-17 and AASHTO M 85-17 Optional Requirements:

Na ₂ Oeq	0.60 max	0.57	False set (%) (C451)	50 min	80
---------------------	----------	------	----------------------	--------	----

* May exceed the SO₃ maximum based on C 1038 results of <0.020% expansion at 14 days.

We certify that the above described cement, at the time of shipment, meets the chemical and physical requirements of:

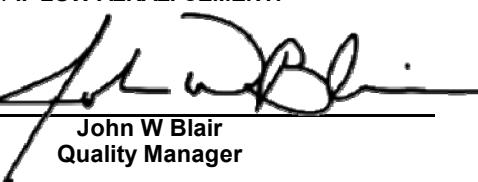
ASTM C 150-24 & AASHTO M 85-24 STANDARD SPECIFICATIONS FOR TYPES I / II CEMENTS; and

ASTM C 150-24 & AASHTO M 85-24 OPTIONAL CHEMICAL REQUIREMENTS FOR TYPES I / II LOW ALKALI CEMENT.

AASHTO Accreditation Exceptions: C430 sand C191

Western Canada BU - Exshaw Plant
P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
Phone: 403-673-3815

Certified By:


John W Blair
Quality Manager



Certified to
NSF/ANSI/CAN 61





Cement Mill Test Report

Date of Issue: December 8, 2025

Plant: Exshaw AB
Product: Portland Cement Type I/II
Mill Test Report Number: ESW_Type I-II 2025-11
Manufactured: November 2025

ASTM C 150-24 and AASHTO M 85-24 Standard Requirements

Additional Data

Item	Test Result	
	Limestone	Inorganic Process Addition Lafarge Cement Kiln Dust
Amount (%)	4.0	--
SiO ₂ (%)	1.8	14.4
Al ₂ O ₃ (%)	0.6	3.5
Fe ₂ O ₃ (%)	0.2	2.2
CaO (%)	49.4	50.4
SO ₃ (%)	0.2	2.5
CO ₂ (%)	42.4	n/a

Base Cement Phase Composition

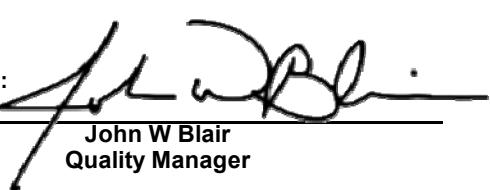
Item	Test Result
C ₃ S (%)	59
C ₂ S (%)	12
C ₃ A (%)	5
C ₄ AF (%)	11

Specific Gravity: 3.14 For information purposes only.

We certify that the data above reflects the materials used in cement manufacture during the production period indicated.

Western Canada BU - Exshaw Plant
P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
Phone: 403-673-3815

Certified By:


John W Blair
Quality Manager