



Cement Mill Test Report

Date of Issue: March 17, 2026

Plant: Exshaw, AB
Product: Portland Cement Type III
Mill Test Report Number: ESW_Type III 2026-02
Manufactured: February 2026

ASTM C 150-24 and AASHTO M 85-24 Standard Requirements

Additional Data

Item	Test Result	
	Limestone	Inorganic Process Addition Lafarge Cement Kiln Dust
Amount (%)		0.5
SiO ₂ (%)	1.6	14.4
Al ₂ O ₃ (%)	0.5	3.5
Fe ₂ O ₃ (%)	0.2	2.3
CaO (%)	48.6	51.1
SO ₃ (%)	0.2	2.6
CO ₂ (%)	42.7	n/a

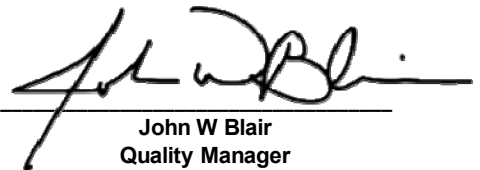
Base Cement Phase Composition

Item	Test Result
C ₃ S (%)	61
C ₂ S (%)	11
C ₃ A (%)	5
C ₄ AF (%)	10

We certify that the data above reflects the materials used in cement manufacture during the production period indicated.

Western Canada BU - Exshaw Plant
P.O. Box 160, Highway 1A, Exshaw AB, T0L 2C0
Phone: 403-673-3815

Certified By:


John W Blair
Quality Manager